

FILED

NOV 21 2007

Mark S. Sheldon
CHAMPAIGN COUNTY CLERK

ILLINOIS STATE BOARD OF EDUCATION

School Financial Services Center
School Business and Support Services Division
100 North First Street
Springfield, Illinois 62777

RECEIVED NOV 21 2007

CERTIFICATE OF APPROVAL FOR THE EXPENDITURE OF FIRE PREVENTION AND SAFETY FUNDS
(Section 17-2.11 of the School Code)

This Certificate supersedes the Original Survey or Certificate of Approval dated 06/01/2004 in the amount of \$17,730.00 computed in consideration of Amendment No. 4 dated 05/21/2007.

Previously Approved	\$17,730.00
This Amendment	\$120,000.00
Total Approved to Date	\$137,730.00

I, Christopher A. Koch, Ed.D., State Superintendent of Education, acknowledge receipt of the estimate of cost certified by the architect/engineer required:

1. to bring this school building into compliance with the safety standards set forth in 23 Ill. Adm. Code Part 175, 23 Ill. Adm. Code Part 180, and /or 23 Ill. Adm. Code Part 185 as promulgated by the State Board of Education.
2. to bring the school building into compliance with the Asbestos Abatement Act 105 et seq of the School Code and the Asbestos Hazard Emergency Response Act (AHERA).
3. to provide funds for accessibility pursuant to Section 17-2.11 of the School Code and 71 Ill. Adm. Code Part 400 with funds not necessary for the completion of items under No. 1 above.
4. to provide for necessary school security systems and equipment with funds not necessary for the completion of approved items under No. 1 above.
5. to provide funding for energy conservation pursuant to Section 17-2.11 of the School Code with funds not necessary for the completion of approved items under No. 1 above.
6. to provide funding for repair of school sidewalks, playgrounds, parking lots, or school bus turnarounds pursuant to Section 17-2.11 of the School Code with funds not necessary for the completion of approved items under No. 1 above.

DISAPPROVED ITEMS:

ITEM	DESCRIPTION	AMOUNT	REASON
1,4	Upgrade existing conditions.	\$27,000.00	Not allowed for H/LS funding.
6	Cover plates on electrical panels/junction boxes.	\$180.00	Maintenance; not allowed for H/LS funding.
8	Maintenance items.	\$360.00	Not allowed for H/LS funding.
Fees	Arch'l/ eng'g fees/ contingencies, other fees.	\$1,230.00	In excess of allowable fees funded through H/LS.

*Booked from
11/21/07*

(OAKWOOD CUSD 76-OAKWOOD JUNIOR HIGH SCHOOL-Amdt#4)

CRTAPPVL

ORIGINAL School District

COPY:

Regional Superintendent

County Clerk

Architect

ILLINOIS STATE BOARD OF EDUCATION

School Financial Services Center
School Business and Support Services Division
100 North First Street
Springfield, Illinois 62777

CERTIFICATE OF APPROVAL FOR THE EXPENDITURE OF FIRE PREVENTION AND SAFETY FUNDS

(Section 17-2.11 of the School Code)

I further certify that the estimate of total approval to date, in the amount of \$137,730.00 has been examined and determined to be reasonable and is hereby approved.

Stasz Gorski

GORSKI & REIFSTECK ARCH.

Architect/Engineer

Firm Certifying Estimate of Cost

OAKWOOD JUNIOR HIGH SCHOOL

VERMILION

School Building

County

OAKWOOD CUSD 76

District Name and Number

June 12, 2007

Date

Charles Keel

Signature of State Superintendent of Education

(OAKWOOD CUSD 76-OAKWOOD JUNIOR HIGH SCHOOL-Amdt#4)

CRTAPPVL

ORIGINAL

School District

COPY:

Regional Superintendent

County Clerk

Architect

RECEIVED OCT 19 2007

ORDER TO EFFECT COMPLIANCE WITH THE HEALTH/LIFE SAFETY CODE FOR PUBLIC SCHOOLS

(Section 2-3.12 of the School Code of Illinois)

DISTRICT NAME AND NUMBER Oakwood CUSD 76	COUNTY Vermilion
FACILITY NAME Oakwood Junior High School	FACILITY LOCATION 21600 N 900 East Road, Danville, IL 61834

There has been submitted:


- Report by Greg Wolfe, President of the Board of Education filed on
Name and Title of Person or Board of Education Submitting Report
 _____ May 18, 2007 office; describing conditions of noncompliance with applicable
Date
 codes, with respect to this facility; or
- An Amendment Number 4 in the amount of \$ 120,000.00 .

As it is my duty to enforce the Health/Life Safety Code for Public Schools (23 Illinois Administrative Code Part 180) pursuant to the Provisions of Sections 2-3.12 and 3-14.2 and 3-14.21 of the School Code of Illinois;

Therefore, the Board of Education in Vermilion County, District # 76 is hereby ordered to make such repairs or alterations as necessary to effect full compliance with the applicable provisions of the Health/Life Safety Code for Public Schools, or complete the work itemized in Amendment Number 4 as approved. Urgent items must be completed within one year, while all other items should be completed within the timelines specified on Form 35-48.

Signed this 18th day of October 18, 2007.

Michael R. Metzger
Typed Name of Regional Superintendent


Signature of Regional Superintendent

REGIONAL SUPERINTENDENT'S CERTIFICATE OF APPROVAL TO RAISE OR USE FIRE PREVENTION AND SAFETY FUNDS

DISTRICT NAME AND NUMBER Oakwood Community Unit #76	COUNTY Vermillion
FACILITY NAME Oakwood Junior High School	AMENDMENT NUMBER 4

A Certification of Need for Fire Prevention and Safety Funds was received from said district on August 17, 2005.
Date

The aggregate amount of \$ 17730 has been previously approved as evidenced by a Certificate of Approval dated 6/1/2004.

The proposed work and estimate(s) of costs certified by Gorski Reifsteck Architects
Architect's Name and Firm
as necessary to effect the repairs or alterations recommended in his/her safety survey report or amendment submitted to the local board of education on 9/21/05 and accepted and adopted by them on
Date

9/21/05 in the amount of \$ 148,770 appear to be within the scope of
Date

Section 17-2.11 of the School Code.

Therefore:

Pursuant to the provision of Section 17-2.11 of the School Code of Illinois, I approve the increase in the aggregate amount of funds to be raised or used for Fire Prevention and Safety purpose to \$ 166,500.

An appropriate Order to Effect Compliance with the Health Life Safety Code of Public Schools will be issued by this office upon receipt of the Certificate of Approval of this amendment from the State Superintendent of Education.

This Certificate of Approval is computed on the basis of Amendment Number 4, dated 9/21/05 and supersedes any and all prior Certificates issued with regard to this facility.

Signed this 21st day of May, 2007.


Signature of Regional Superintendent

217-431-2668
Phone Number

217-431-2671
Fax Number

CERTIFICATION OF NEED FOR FIRE PREVENTION AND SAFETY FUNDS
Request for Authorization


This is to certify that:

The Oakwood Junior High school, located at 21600 N. 900 E. Road, Danville, Illinois, and under the management and control of the Board of Education of School District #76, Vermilion County, was surveyed by me on March 2, 2005

- All of the urgent or necessary work as indicated on the attached Form 35-48 is necessary to abate the violations of applicable code requirements and should result in effecting compliance with said requirements within prescribed timelines
- All other work recommended in the attached Form 35-48, though not required to abate violations of applicable requirements of the Health/Life Safety Code for Public Schools, is recommended for energy conservation, handicapped accessibility, school security, and other repair purposes provided in Section 17-2.11 of the School Code.

The certified estimated cost figures were prepared by me and to the best of my knowledge are true and accurate estimates of the costs to execute the work as specified.

Name of Architect/Engineer Stasz Gorski	Name of Firm Gorski Reifsteck Architects
Phone Number 217-351-4100	Fax Number 217-351-4111
License Number 001-010135	Expiration Date 11-30-06
Email Address Stasz@gr-arch.com	

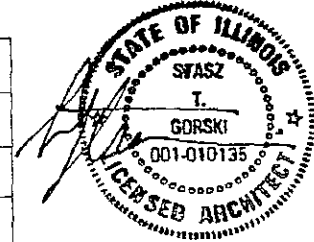

[Seal and Signature]

The local Board of Education hereby certifies and assures the State Board of Education:

- a. Based upon the report of the architect referred to above, the district faces total estimated costs of \$148,770 to finance the work involved.
- b. The district has \$0 available in its operations and maintenance fund and/or fire prevention and safety fund to finance the work.
- c. The district needs to raise \$148,770 in additional revenue through the levy of the Fire Prevention and Safety Tax or issuance of Bonds to finance the recommended work.
- d. Plans and specifications for the work will be submitted to the Regional Superintendent for review and approval.
- e. The work to be financed with Fire Prevention and Safety funds will not commence until the Certificate of Approval of the State Superintendent is received, the detailed plans and specifications have been approved by the regional superintendent and the regional superintendent (or other lawful agency) has issued an appropriate Order to Effect Compliance with the Health/Life Safety Code for public schools (or other lawful order requiring the work to be done).
- f. All work authorized by the District will be executed in conformity with all applicable codes.

Date	Date
Signature of President of Board of Education	Signature of Secretary of Board of Education

Form 35-76 (3/04) (Prescribed by ISBE for local board use)

180 500 a

SCHEDULE OF VIOLATIONS

1. COUNTY CODE/NAME: 092 Vermilion		2. DISTRICT CODE/NAME: 0760 Oakwood C.U. No. 76		3. SITE CODE/NAME: 1001 Oakwood Jr. High School		4. FACILITY CODE/NAME: 1001 Oakwood Jr. High School	
ITEM I.D. (5)	LOCATION NAME(S) & ROOM NUMBER(S) (6)	TYPE (7)	RULE VIOLATED (8)	DESCRIPTION OF THE PROBLEM (9)		CAUSE (10)	
1.	Boiler Room	b	185.485cas	The Boiler is located in a lower room in the building and has the potential of natural gas accumulation in the event of a leak in the piping system		e	
2.	Boys and Girls Locker Rooms	b	175.560	The boys and girls locker rooms do not have power exhaust systems to properly ventilate odors and provide acceptable indoor air quality.		e	
3.	Boiler Room	c	185.620	The existing make-up water line to the steam boiler does not have a backflow device to prevent backflow contamination from entering the schools well and water system.			
4.	Exterior Parking Area North of School	d	185.520	Overhead service drop does not have adequate minimum clearance for vehicular traffic.		c	
5.	Main Electric Service in Boiler Room	d	185.540	Tap conductors on the load side of the service disconnect switch are too small to be properly protected by the fuses of the switch. Too many conductors are terminated at the lugs to meet the listed application of the connector. Branch circuit panels are worn beyond normal life.		c	
6.	Branch Panel in Boiler Room	d	185.550	Branch panel is missing blank covers over removed circuit breaker resulting in exposed live bus.		e	
7.	Branch Panel in Kitchen	d	185.550	Branch panel is missing blank covers over removed circuit breaker resulting in exposed live bus.		e	
8.	Band Room	d	185.550	Raceway/fitting damaged at device box for A/C unit power outlet resulting in exposed conductors.		f	

SCHEDULE OF WORK ITEMS AND ESTIMATED COSTS

FOR ROE USE ONLY	AMENDMENT NUMBER
	AMENDMENT DATE

1. COUNTY CODE/NAME: 092 Vermilion		2. DISTRICT CODE/NAME: 0760 Oakwood C.U. No. 76		3. SITE CODE/NAME: 1001 Oakwood Jr. High School		4. FACILITY CODE/NAME: 1001 Oakwood Jr. High School	
ITEM I.D. (5)	ACTION I.D. (6)	PRIORITY CODE (7)	SPECIFICATION(S) (8)	QUANTITY (10)	LABOR CODE (11)	ESTIMATED COST (12)	ESTIMATED COMPLETION DATE (13)
1.	f	b	Provide a power exhaust system for the boiler room and natural gas monitor/detection system. When the detector system is activated the gas valve shall close, power exhaust system shall operate, and the boiler burner shall shut off.	1	2	\$ 20,000	Fall 2008
2.	f	b	Provide a power exhaust ventilation system for the boys and girls locker rooms	1	2	\$ 20,000	Fall 2008
3.	f	b	Provide a backflow device in the make-up water line to the steam boiler	1	2	\$ 5,000	Fall 2009
4.	c	b	Raise overhead service drop conductors to be a minimum of 18' above parking lot pavement.	1	2	\$ 2,500	Fall 2007
5.	f	b	Replace existing branch circuit panels and power feeder cabling	1	2	\$ 75,000	Fall 2009
6, 7.	c	a	Provide missing blank plates at open panel branch breaker spaces	1	1	\$ 150	Fall 2006
8.	c	a	Repair conduit fitting at A/C unit power outlet	1	1	\$ <u>300</u>	Fall 2006
				Sub-Total		\$ 122,950	
				10% Contingency		\$ 12,295	
				10% A/E Fees		\$ <u>13,525</u>	
				Total Amount Requested		\$ 148,770	

RECEIVED SEP 16 2007

ILLINOIS STATE BOARD OF EDUCATION

School Financial Services Center
School Business and Support Services Division
100 North First Street
Springfield, Illinois 62777

RECEIVED SEP 14 2007

CERTIFICATE OF APPROVAL FOR THE EXPENDITURE OF FIRE PREVENTION AND SAFETY FUNDS

(Section 17-2.11 of the School Code)

This Certificate supersedes the Original Survey or Certificate of Approval dated 06/12/2007 in the amount of \$1,205,354.00 computed in consideration of Amendment No. 12 dated 07/23/2007.

Table with 2 columns: Description and Amount. Rows include Previously Approved (\$1,205,354.00), This Amendment (\$105,200.00), and Total Approved to Date (\$1,310,554.00).

I, Christopher A. Koch, Ed.D., State Superintendent of Education, acknowledge receipt of the estimate of cost certified by the architect/engineer required:

- 1. [X] to bring this school building into compliance with the safety standards set forth in 23 Ill. Adm. Code Part 175, 23 Ill. Adm. Code Part 180, and /or 23 Ill. Adm. Code Part 185 as promulgated by the State Board of Education.
2. [] to bring the school building into compliance with the Asbestos Abatement Act 105 et seq of the School Code and the Asbestos Hazard Emergency Response Act (AHERA).
3. [] to provide funds for accessibility pursuant to Section 17-2.11 of the School Code and 71 Ill. Adm. Code Part 400 with funds not necessary for the completion of items under No. 1 above.
4. [] to provide for necessary school security systems and equipment with funds not necessary for the completion of approved items under No. 1 above.
5. [] to provide funding for energy conservation pursuant to Section 17-2.11 of the School Code with funds not necessary for the completion of approved items under No. 1 above.
6. [] to provide funding for repair of school sidewalks, playgrounds, parking lots, or school bus turnarounds pursuant to Section 17-2.11 of the School Code with funds not necessary for the completion of approved items under No. 1 above.

DISAPPROVED ITEMS:

Table with 3 columns: ITEM, DESCRIPTION, AMOUNT, REASON. Row 2: Accessible entrance to areas, \$7,200.00, In excess of ADA provisions allowed for H/L/S funding.

COMMENTS:

\$17,800.00 available in the Operations & Maintenance fund and/or Fire Prevention & Safety fund is approved to correct the violations in addition to the amount shown above (\$105,200.00) The total amount approved to correct the violations: \$123,000.00

FILED

NOV 21 2007

Mark A. Holden
CHAMPAIGN COUNTY CLERK

(OAKWOOD CUSD 76-OAKWOOD HIGH SCHOOL-Amdt#12)

ILLINOIS STATE BOARD OF EDUCATION

School Financial Services Center
School Business and Support Services Division
100 North First Street
Springfield, Illinois 62777

CERTIFICATE OF APPROVAL FOR THE EXPENDITURE OF FIRE PREVENTION AND SAFETY FUNDS

(Section 17-2.11 of the School Code)

I further certify that the estimate of total approval to date, in the amount of \$1,310,554.00 has been examined and determined to be reasonable and is hereby approved.

Stasz Gorski

GORSKI & REIFSTECK ARCH.

Architect/Engineer

Firm Certifying Estimate of Cost

OAKWOOD HIGH SCHOOL

VERMILION

School Building

County

OAKWOOD CUSD 76

District Name and Number

September 10, 2007

Christina Koch

Date

Signature of State Superintendent of Education

(OAKWOOD CUSD 76-OAKWOOD HIGH SCHOOL-Amdt#12)

REGIONAL SUPERINTENDENT'S CERTIFICATE OF APPROVAL TO RAISE OR USE FIRE PREVENTION AND SAFETY FUNDS

DISTRICT NAME AND NUMBER Oakwood Community Unit #76	COUNTY Vermilion
FACILITY NAME Oakwood High School	AMENDMENT NUMBER 12

A Certification of Need for Fire Prevention and Safety Funds was received from said district on July 19, 2007.
Date

The aggregate amount of \$1205354.00 has been previously approved as evidenced by a Certificate of Approval dated 6/12/2007.

The proposed work and estimate(s) of costs certified by Gorski Reifsteck Architects
Architect's Name and Firm
as necessary to effect the repairs or alterations recommended in his/her safety survey report or amendment submitted to the local board of education on 7/06/2007 and accepted and adopted by them on
Date

7/18/2007 in the amount of \$ 112,400.00 appear to be within the scope of
Date
Section 17-2.11 of the School Code.

Therefore:

Pursuant to the provision of Section 17-2.11 of the School Code of Illinois, I approve the increase in the aggregate amount of funds to be raised or used for Fire Prevention and Safety purpose to \$1,317,754.00.

An appropriate Order to Effect Compliance with the Health Life Safety Code of Public Schools will be issued by this office upon receipt of the Certificate of Approval of this amendment from the State Superintendent of Education.

This Certificate of Approval is computed on the basis of Amendment Number 12, dated 7/18/2007 and supersedes any and all prior Certificates issued with regard to this facility.

Signed this 23rd day of July, 2007.


Signature of Regional Superintendent

217-431-2668
Phone Number

217-431-2671
Fax Number

Form 36-21 (3/04) Prescribed by Regional Superintendent for Regional Superintendent's use

180.500 d)

CERTIFICATION OF NEED FOR FIRE PREVENTION AND SAFETY FUNDS Request for Authorization


I am certifying that:

The 0001 Oakwood High school, located at 5870 UR Route 150
School Name Street
Fithian Illinois, and under the management and control of the Board of Education of
City
 School District # 76 Vermilion County, was surveyed by me on 7/3/07

- All of the urgent or necessary work as indicated on the attached Form 35-48 is necessary to abate the violations of applicable code requirements and should result in effecting compliance with said requirements within prescribed timelines.
- All other work recommended in the attached Form 35-48, though not required to abate violations of applicable requirements of the Health/Life Safety Code for Public Schools, is recommended for energy conservation, handicapped accessibility, school security, and other repair purposes provided in Section 17-2.11 of the School Code.

The certified estimated cost figures were prepared by me and to the best of my knowledge are true and accurate estimates of the costs to execute the work as specified.

Name of Architect/Engineer Stasz Gorski	Name of Firm Gorski Reilsteak Architects
Phone Number 217-351-4100	Fax Number 217-351-4111
License Number 001010135	Expiration Date 11/30/08
Email Address stasz@gr-arch.com	

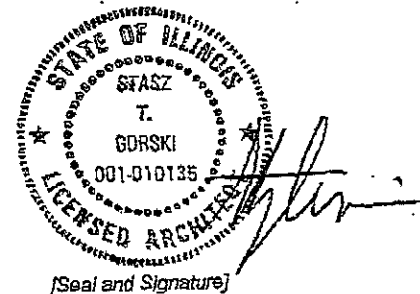

The local Board of Education hereby certifies and assures the State Board of Education:

- Based upon the report of the architect referred to above, the district faces total estimated costs of \$ 130,200 to finance the work involved.
- The district has \$ 17,800 available in its operations and maintenance fund and/or fire prevention and safety fund to finance the work.
- The district needs to raise \$ 112,400 additional revenue through the levy of the Fire Prevention and Safety Tax or issuance of Bonds to finance the recommended work.
- Plans and specifications for the work will be submitted to the Regional Superintendent for review and approval.
- The work to be financed with Fire Prevention and Safety funds will not commence until the Certificate of Approval of the State Superintendent is received, the detailed plans and specifications have been approved by the regional superintendent and the regional superintendent (or other lawful agency) has issued an appropriate Order to Effect Compliance with the Health/Life Safety Code for public schools (or other lawful order requiring the work to be done).
- All work authorized by the District will be executed in conformity with all applicable codes.

7/18/07 [Signature] Date Signature of President of Board of Education
7/19/07 [Signature] Date Signature of Secretary of Board of Education
 Form 35-76 (3/04) (Prescribed by ISBE for local board use) 180,500 a

SCHEDULE OF WORK ITEMS AND ESTIMATED COSTS

FOR ROE USE ONLY	AMENDMENT NUMBER
	AMENDMENT DATE

1. COUNTY CODE/NAME: 092 Vermilion			2. DISTRICT CODE/NAME: 076 Oakwood CUSD 76			3. SITE CODE/NAME: 0001 Oakwood High School			4. FACILITY CODE/NAME: Oakwood High School		
ITEM I.D. (5)	ACTION I.D. (6)	PRIORITY CODE (7)	SPECIFICATION(S) (8)	QUANTITY (10)	LABOR CODE (11)	ESTIMATED COST (12)	ESTIMATED COMPLETION DATE (13)				
1.	B	B	Replace the existing fire alarm system.	1 System	2	\$95,000	Fall 2007				
2.	F	C	Provide accessible entrance at west end of corridor 1401 by replacing concrete pad, add curb ramp, and replace door hardware.	Unit	2	\$6,000	Fall 2007				
3.	B	B	Replace the existing non-operational power exhaust fan serving the Football locker room with toilets.	1	2	\$5,000	Fall 2009				
4.	B	B	Replace the existing non-operational power exhaust fan serving the Girl's Locker Room	1	2	\$2,500	Fall 2007				
SUBTOTAL						\$108,500					
10% CONTINGENCY						\$10,850					
10% A/E FEES						\$10,850					
TOTAL AMOUNT REQUESTED						\$130,200					

Form 35-48 (3/04) (Prescribed by ISBE for local board use)